
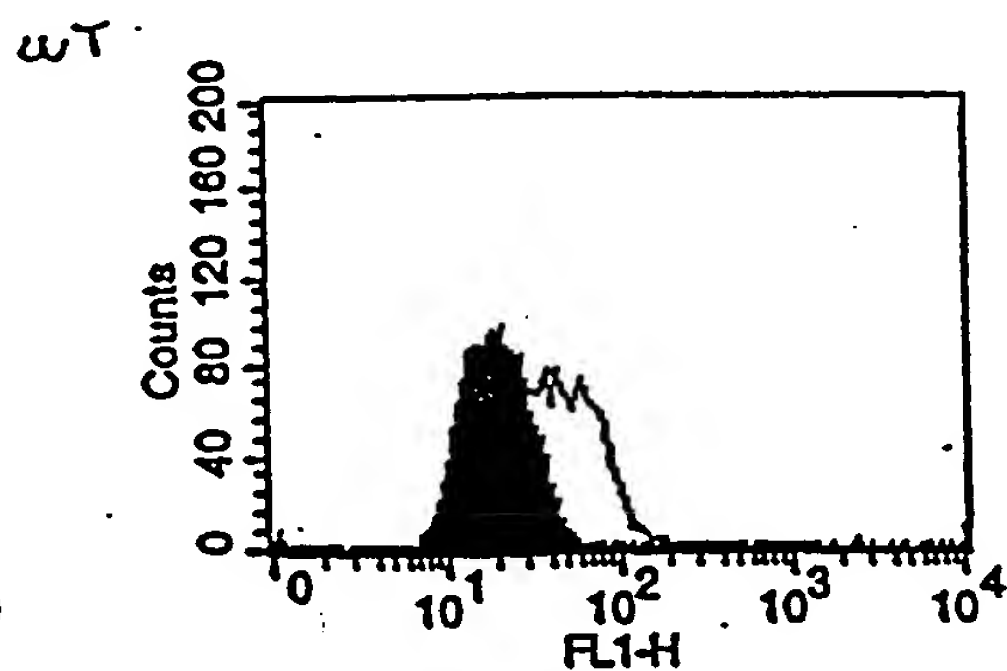




FIGURE 1

PANEL A

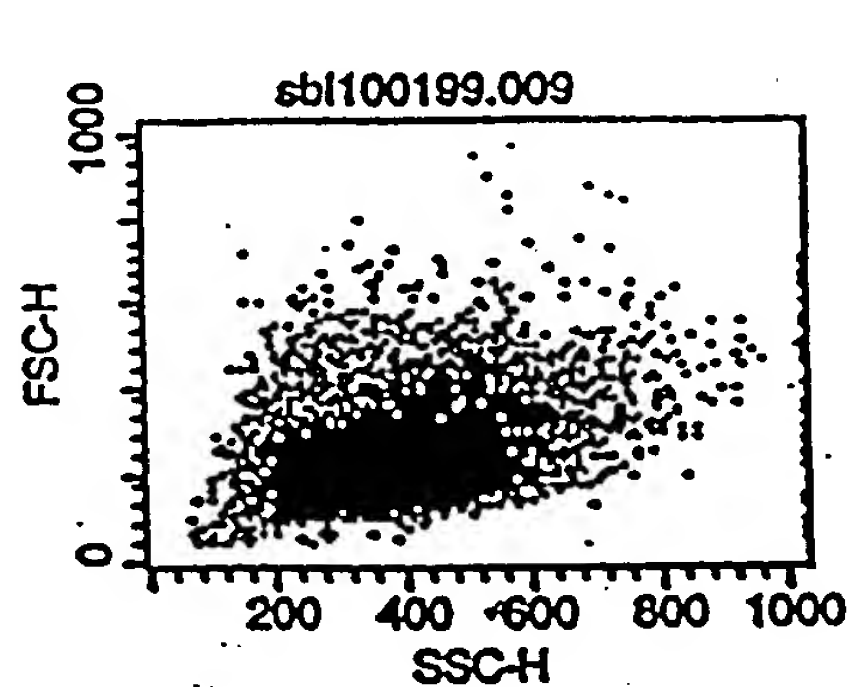

WT



PANEL B

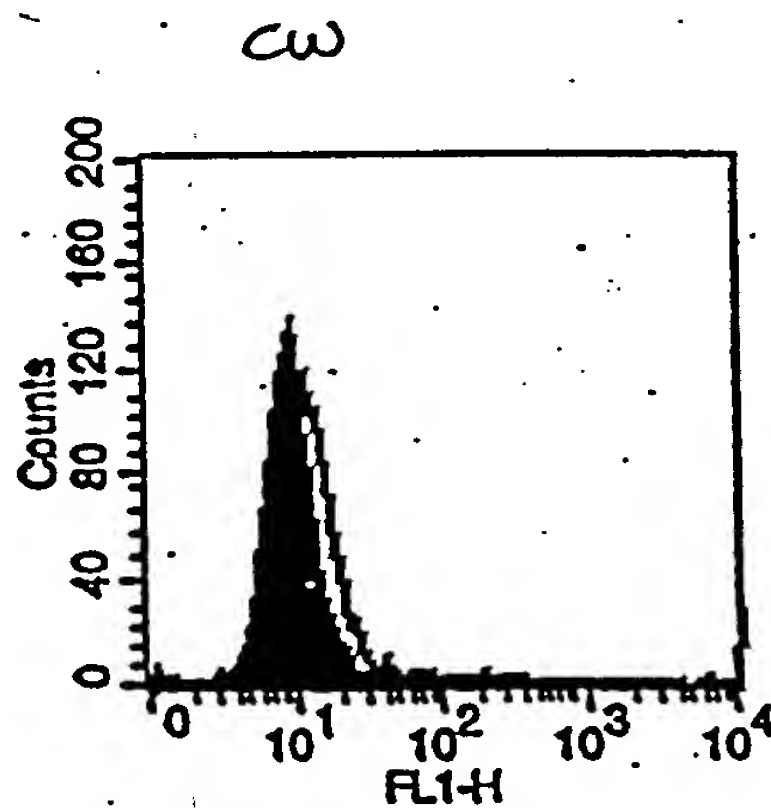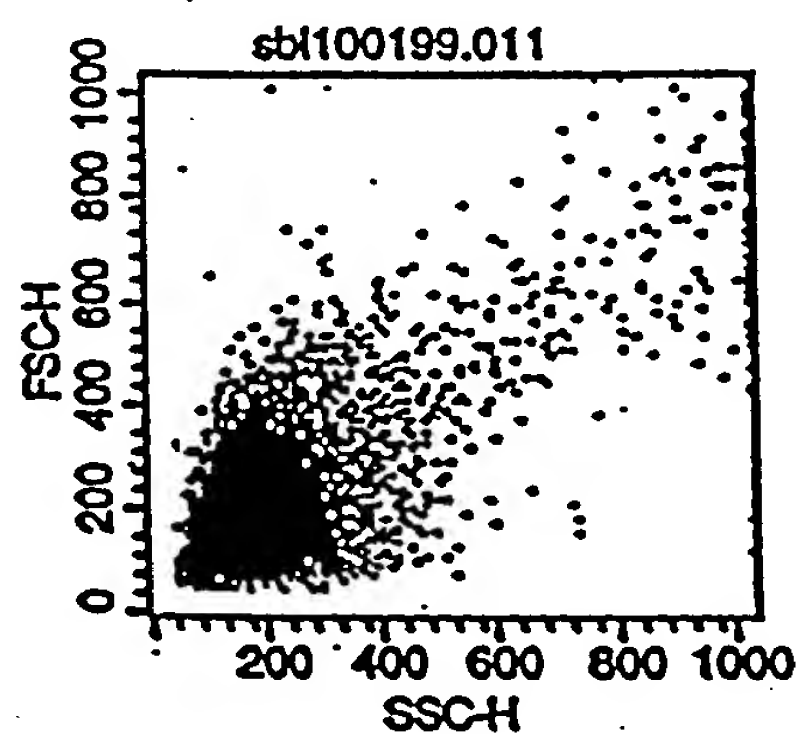

CW



FIGURE 2

PANEL A

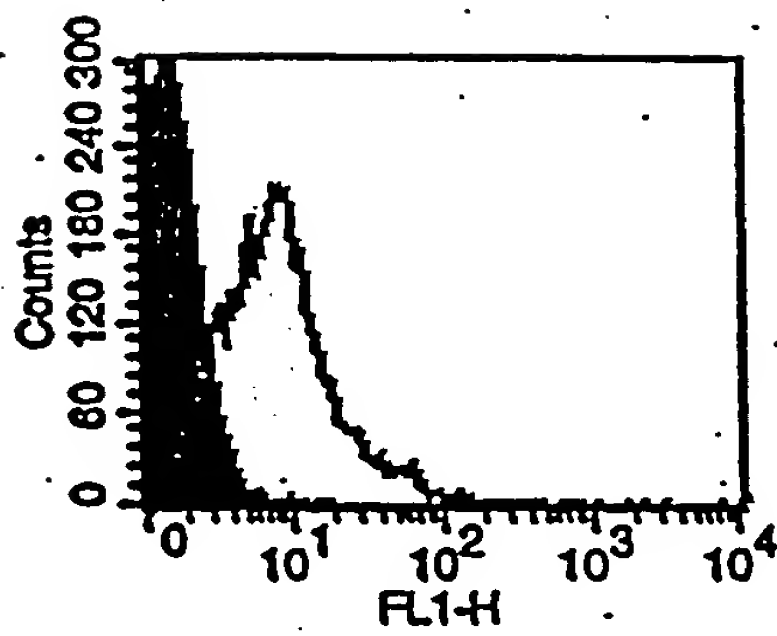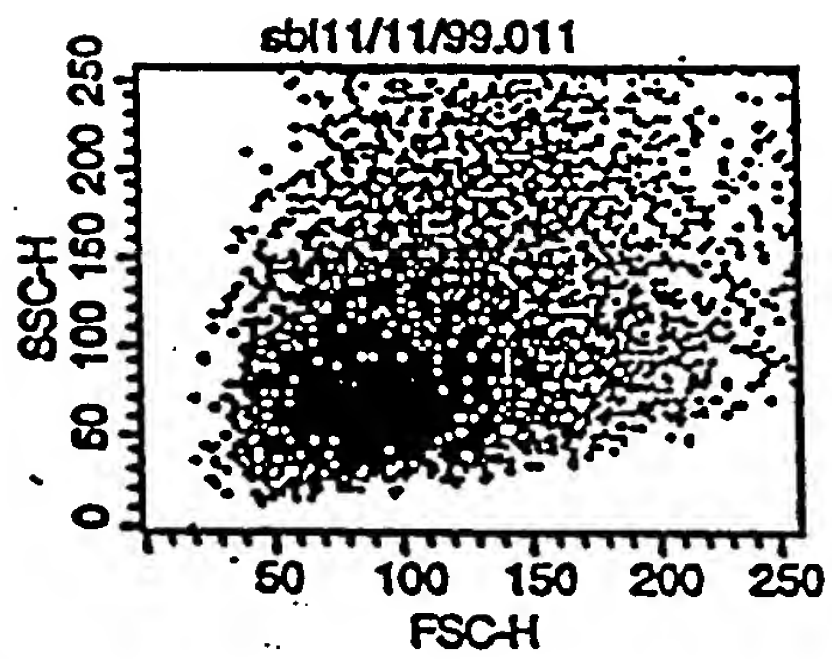

LTS


PANEL B

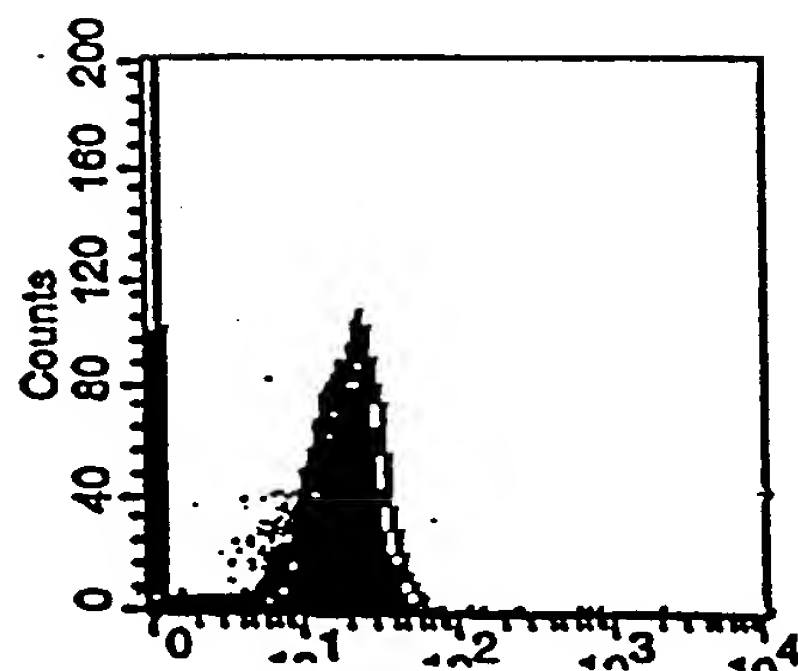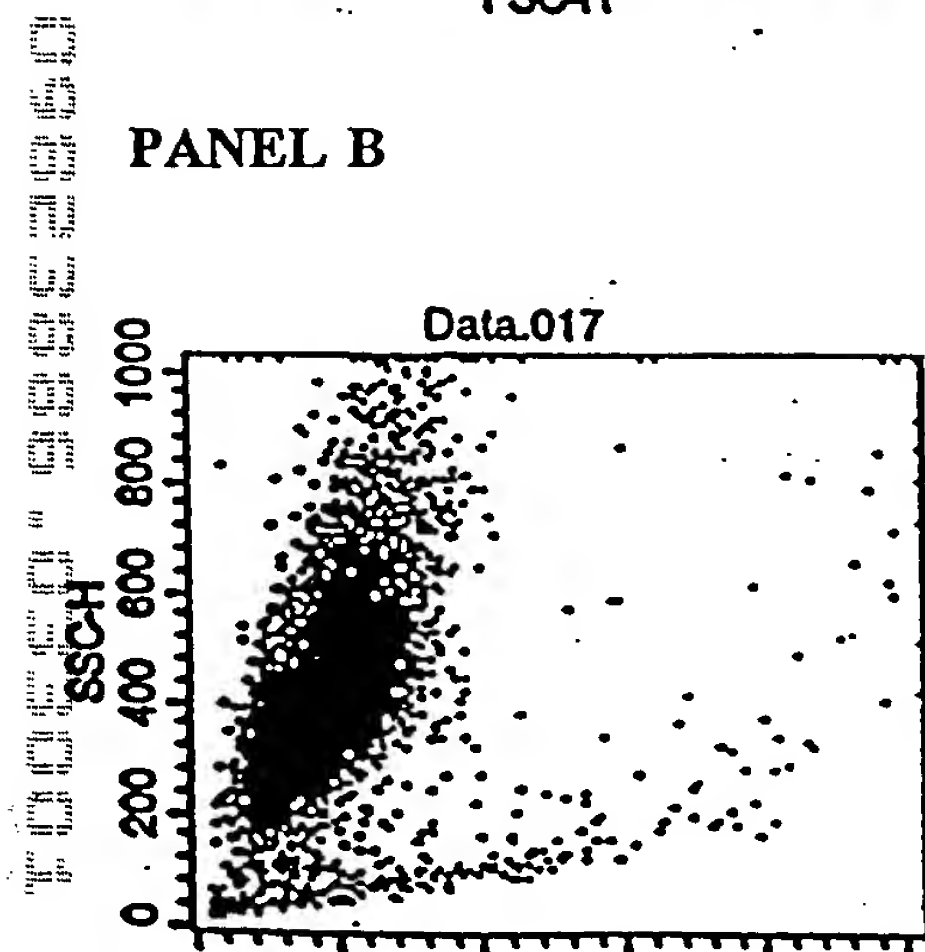


cc2654  
dk-diz

[illegible]

## 24 HR. TREATMENT

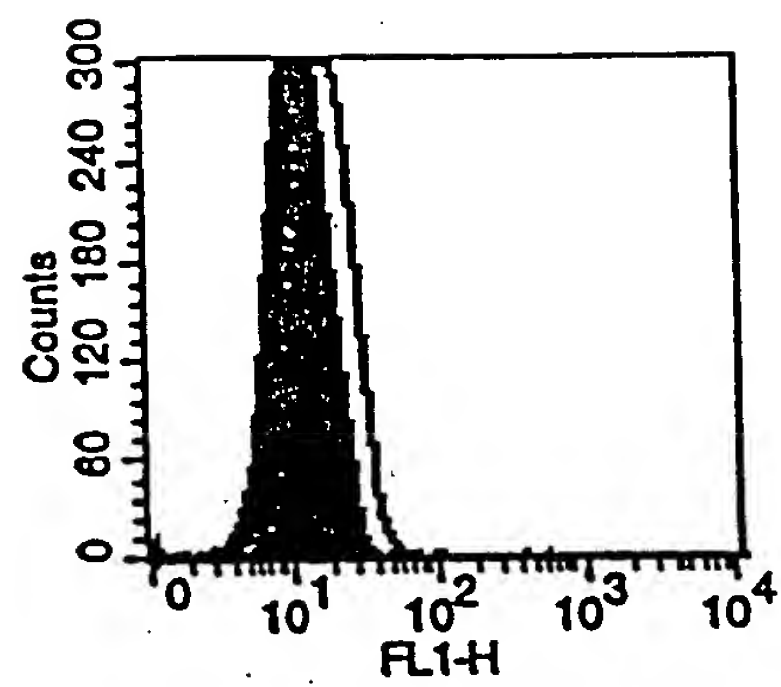

## 24 HR. TREATMENT

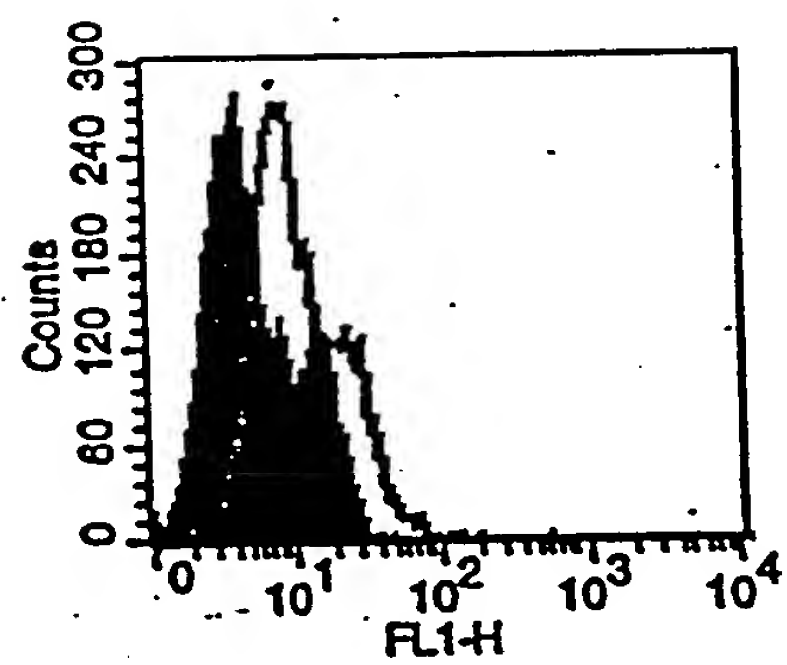

## 49 HR TREATMENT



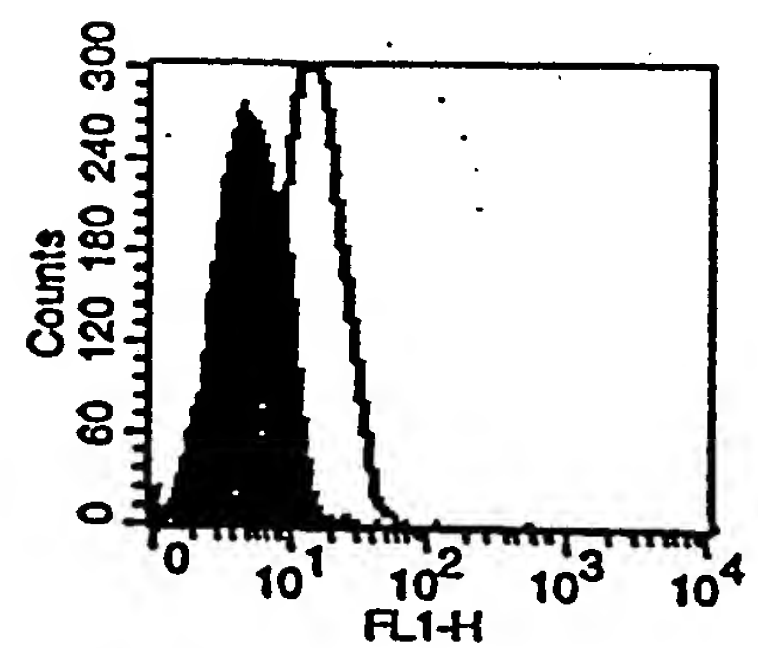


Figure 4

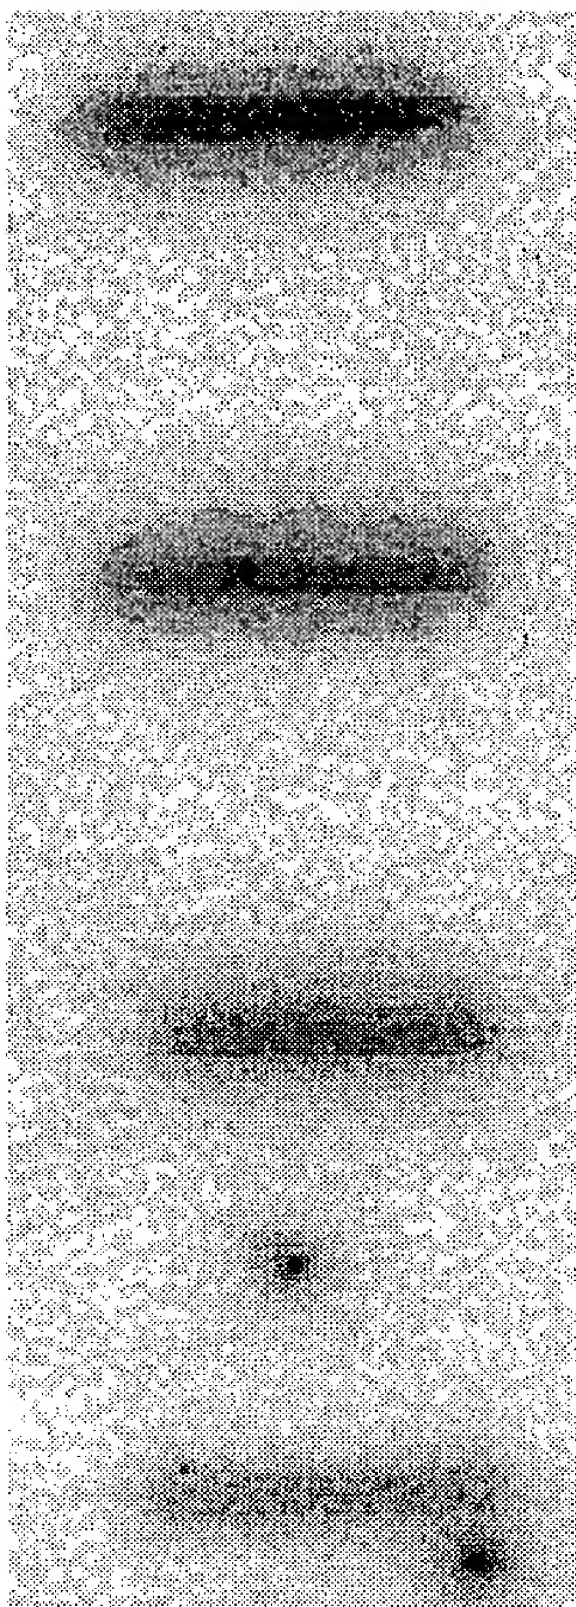

Wild type  
treated with  
norflurazone

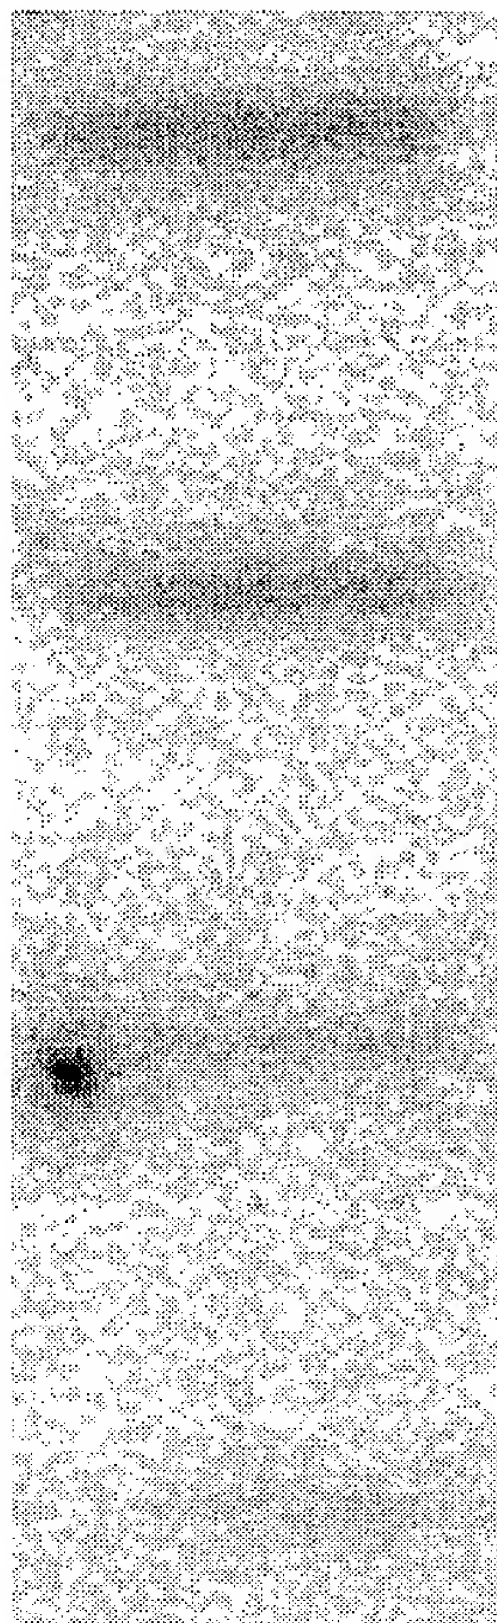

light  
sensitive  
ITS

[illegible]